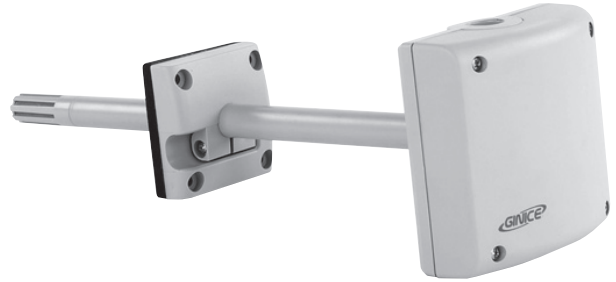


1-4

덕트 온도 감지기
GDT Series

◀ 적용 | Application |

"GDT" Duct Temperature Sensor is intended for heating, ventilation, air conditioning and other industrial installations for control and receiving reference signals in a air duct system. Units contain either a high quality platinum or thermistor (NTC) sensing element suitable for use in the range $-30 \sim +130^{\circ}\text{C}$.

- Sensor for Air supplying or distributing
- Limit Sensor (in case of limiting lowest value for air supplying)
- Shift Sensor (in case of revising room temperature depending on outside temperature)
- Measuring sensor (In case of displaying sensing value or using auto control system for building)

◀ 기술 사양 | Technical Data |

모델	검출 소자	온도 범위	정밀도	결선	적용
(RTD.. 소자)					
GDT-100	Pt100 Ω	$-30 \sim 130^{\circ}\text{C}$	$\pm 0.3^{\circ}\text{C}$ (at 0°C)	3wire / 1.0mm ²	
GDT-1000	Pt1000 Ω	$-30 \sim 130^{\circ}\text{C}$	$\pm 0.3^{\circ}\text{C}$ (at 0°C)	3wire / 1.0mm ²	
(Thermistor.. NTC 소자)					
GDT-N10K-AN	NTC10000 Ω	$-30 \sim 130^{\circ}\text{C}$	$\pm 0.2^{\circ}\text{C}$ (at 25°C)	2wire / 1.0mm ²	ACI/AN, ANDOVER, BA/10K-3 PRECON-3 (Model.3)
GDT-N10K-CP	NTC10000 Ω	$-30 \sim 130^{\circ}\text{C}$	$\pm 0.2^{\circ}\text{C}$ (at 25°C)	2wire / 1.0mm ²	ACI/CP, BA/10K-2 PRECON-2 (Model.24)
GDT-N5K	NTC5000 Ω	$-30 \sim 110^{\circ}\text{C}$	$\pm 0.3^{\circ}\text{C}$ (at 25°C)	2wire / 1.0mm ²	
GDT-N3K	NTC3000 Ω	$-30 \sim 110^{\circ}\text{C}$	$\pm 0.25^{\circ}\text{C}$ (at 25°C)	2wire / 1.0mm ²	ACI/3K PRECON-2 (Model.22)


◀ 기술 사양 | Technical Data |

- 검출 소요 시간 : 30sec at 2m/sec Velocity
- 주위 온도 : $-30 \sim +130^{\circ}\text{C}$
- 주위 습도 : 5 ~ 95% RH
- 적용 : DDC System and controller
- 온도 변화 : Table of Reference Values
- 보호 등급 : IP65
- 케이블 인입 그랜드 : PF 1/2"
- 무게 : 0.06Kg


설치 방법 | Mounting Guide |

- On controlling supplying air temperature:
 - Install at behind of Fan in case of installing Fan at the last air control unit
 - For other case, install at minimum 1.5m away from the last air unit
- Use a shield line which should be separated from power line (AC100/200V)
- Mounting position:
 - When the detector has to be mounted on supply duct the detector must be kept between 3 to 8 meters from the humidifier unit. For accurate measurement of the temperature follow recommendation as:
 - With spray water fogger: between 5 to 8 meters

결선 방법 | Wiring Diagram |

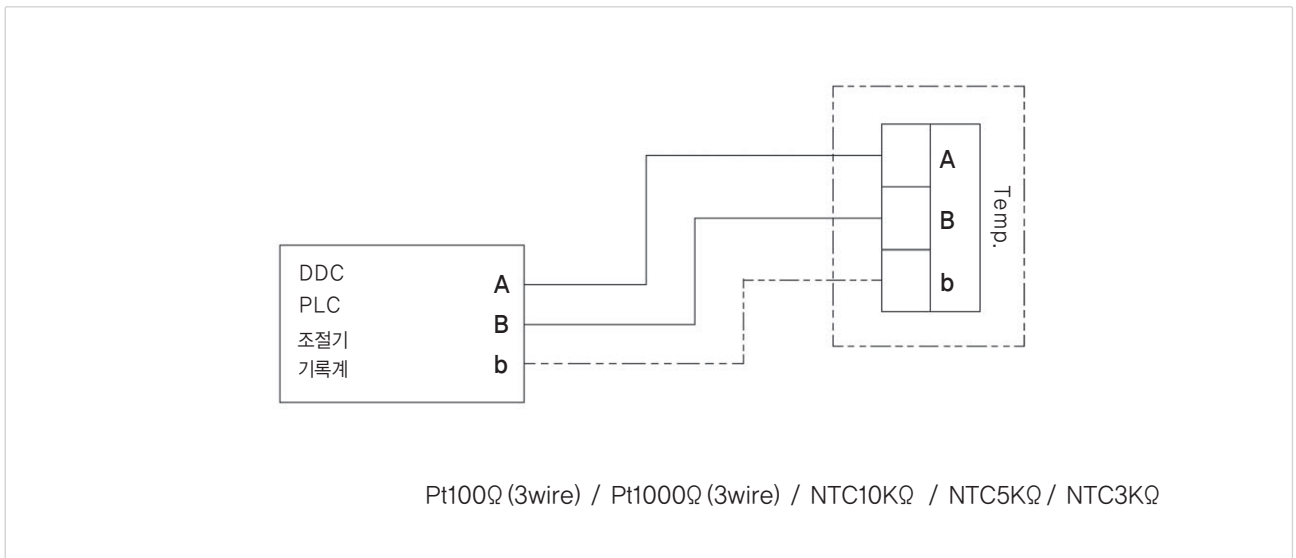

외형치수 | Shape Dimension |

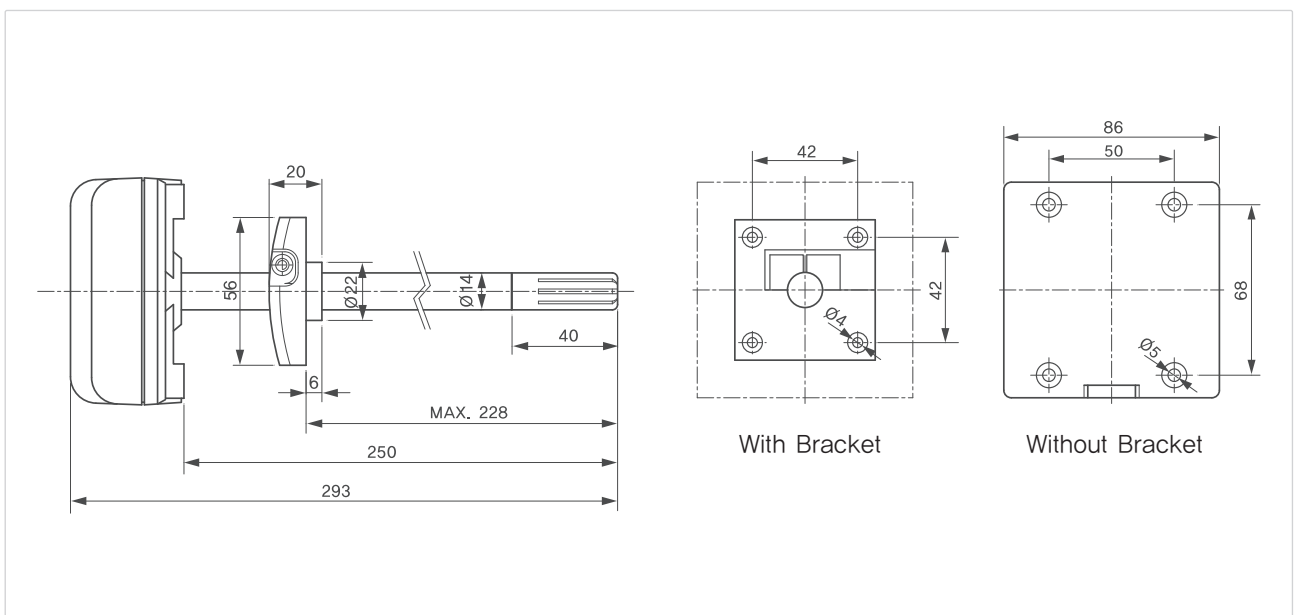

저항 변화표 | Thermistor NTC Curve Table

온 도		NTC/10K-AN	NTC/10K-CP	NTC/5K	NTC/3K
Temp	Temp	Resistance	Resistance	Resistance	Resistance
℃	℉	ohms	ohms	ohms	ohms
-40	-40	239,831	335,671	88,910	100,701
-35	-31	179,280	242,195	68,190	72,658
-30	-22	135,233	176,683	52,870	53,005
-25	-13	102,890	130,243	41,210	39,073
-20	-4	78,930	96,974	32,440	29,092
-15	5	61,030	72,895	25,660	21,868
-10	14	47,549	55,298	20,480	16,589
-5	23	37,316	42,314.6	16,430	12,694.4
0	32	29,490	32,650.8	13,290	9,795.2
5	41	23,462	25,395.5	10,800	7,618.7
10	50	18,787	19,903.5	8,840	5,971.1
15	59	15,136	15,714.0	7,267	4,714.2
20	68	12,268	12,493.7	6,013	3,748.1
25	77	10,000	10,000	5,000	3,000
30	86	8,197	8,056.0	4,179	2,416.8
35	95	6,754	6,530.1	3,508	1,959.0
40	104	5,594	5,324.9	2,961	1,597.5
45	113	4,656	4,366.9	2,509	1,310.1
50	122	3,893	3,601.0	2,137	1,080.3
55	131	3,271	2,985.1	1,826	895.52
60	140	2,760	2,487.1	1,567	746.12
65	149	2,339	2,082.3	1,350	624.69
70	158	1,990	1,751.6	1,169	525.49
75	167	1,700	1,480.1	1,014	444.04
80	176	1,458	1,256.2	883.5	376.85
85	185	1,255	1,070.6	772.2	321.17
90	194	1,084	916.11	677.1	274.83
95	203	939.6	786.99	596.1	236.10
100	212	817.2	678.63	526.5	203.59
105	221	713.0	587.31	465.4	176.19
110	230	624.1	510.06	412.8	153.02
115	239	547.9	444.48	-	133.34
120	248	482.5	388.59	-	116.578
125	257	426.0	340.82	-	102.246
130	266	377.2	299.82	-	89.946
135	275	334.9	264.54	-	79.363
140	284	298.1	234.08	-	70.225
145	293	266.0	207.70	-	62.309
150	302	238.0	184.79	-	55.436